

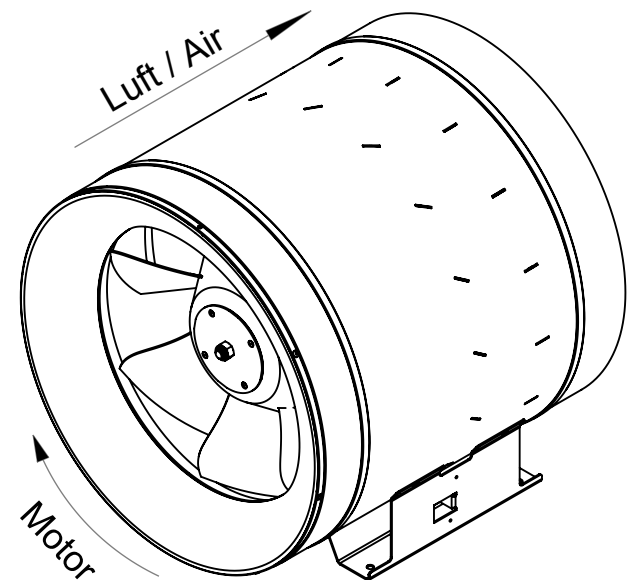


1:6

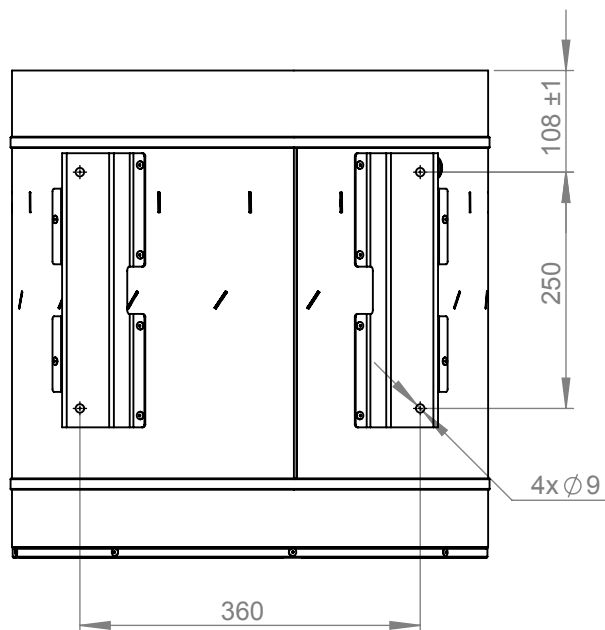

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg

Protection Mark according to ISO16016  
General tolerances DIN ISO 2768-c  
Drawn: h.sachsenheimer 21.04.17  
Created: h.sachsenheimer 21.04.17  
Changed: h.sachsenheimer 25.04.17

**EL500EC10**

**139780 00**